

Kit # R20771

The FT Series, floor standing, condensing boiler is configured for Natural Gas (NG) from the factory. A Natural Gas to Propane Conversion Kit is included with every FT. The gas conversion kit will show you how to convert your FT boiler to propane gas. If your FT does not have the bag containing the conversion kit, a replacement kit can be obtained. Contact the manufacturer and request a replacement conversion kit.

NOTICE

If your installation altitude is greater than 2000 ft, please check that the 'High Altitude' Installer Setting has been adjusted to suit your installation altitude. Refer to Section 4.12 of the Installation and Operation Instructions (Document 1320).

WARNING

This gas conversion kit shall be installed by a qualified service agency in accordance with the manufacturer's instructions and all applicable codes and requirements of the authority having jurisdiction. The information in these instructions must be followed to minimize the risk of fire or explosion or to prevent property damage, personal injury or death. The qualified service agency is responsible for the proper installation of this kit. The installation is not proper and complete until the operation of the converted appliance is checked as specified in the manufacturer's instructions supplied with the kit.

Installation must conform to local codes and the latest edition of the National Fuel Gas Code, ANSI Z223.1 and CAN-B149.1. Failure to follow instructions could result in serious injury or property damage. The qualified agency performing this work assumes responsibility for gas conversion.

CAUTION

This combination boiler has already been set to burn natural gas, but can be converted to burn LP gas. Before placing the combination boiler into operation, verify that your fuel source is natural gas. Or verify that your fuel source is propane if you are converting this combination unit to propane.

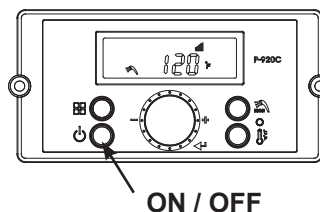
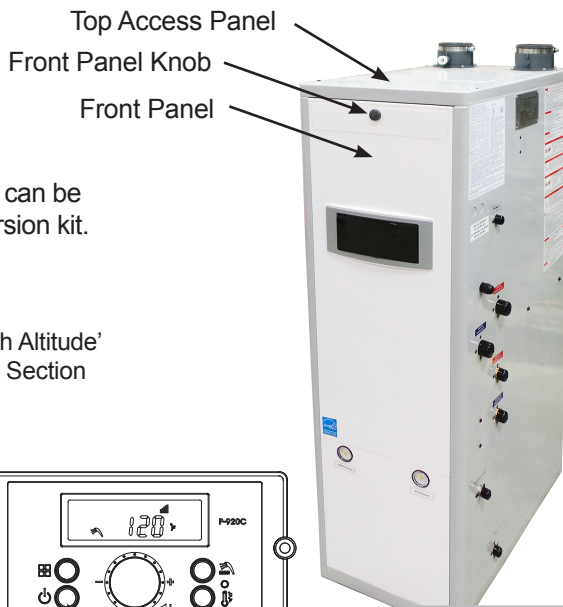


Figure A

Steps 1 thru 26

To convert from Natural Gas to Propane Gas

1. Turn **OFF** the FT. The **ON / OFF** button is located at the bottom left of the Control Display.
2. Turn **OFF** the GAS and WATER supply to the FT (valves are located on the plumbing pipes.)

	Natural Gas (NG) Part #	Propane Gas (LP) Part #
FTCF140	FT1722	FT1722P
FTCF199	FT1780	FT1802




Table A

WARNING

This conversion shall be installed by a qualified service agency in accordance with the manufacturer's instructions and all applicable codes and requirements of the authority having jurisdiction. If the information in these instructions is not followed exactly, a fire, an explosion or production of carbon monoxide may result causing property damage, personal injury or loss of life. The qualified service agency is responsible for the proper and complete installation of this kit. The installation is not proper and complete until the operation of the converted appliance is checked as specified in the manufacturer's instruction supplied with the kit.


AVERTISSEMENT

Ce conversion doit être installé par un organisme de service conformément aux instructions du fabricant et tous les codes et les exigences de l'autorité compétente. Si les informations contenues dans ces instructions n'est pas suivi à la lettre, un incendie, une explosion ou de la production de monoxyde de carbone mais résultat causant des dommages matériels, des blessures ou des pertes de vie. Le service est responsable pour la bonne et complète l'installation de ce kit. L'installation n'est pas correcte et complète jusqu'à ce que le fonctionnement de l'appareil converti est vérifiée comme spécifié dans le manuel d'instruction fourni avec le kit.

H2373900B

3. Using a Phillips screwdriver, remove the 4 screws on the Top Access Panel, and then lift out the Top Access Panel.
4. Unthread the Front Panel Knob at the top of the front panel and then remove the entire panel. See Figure A.
5. With the internal components exposed, locate the gas inlet pipe of your model. See Figure B.

FTCF140

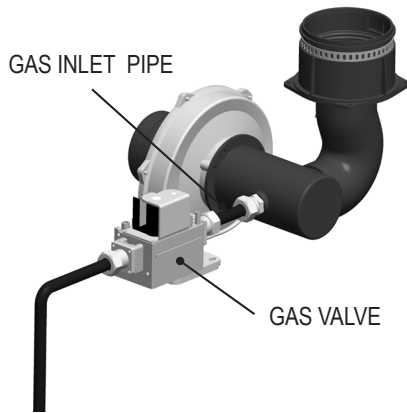

FTCF199


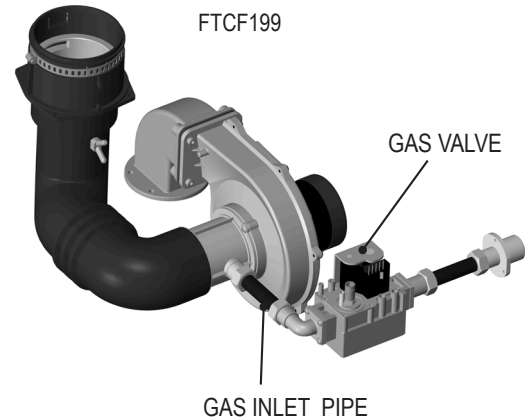


Figure B

6. Loosen the hex-nuts on the Gas Inlet Pipe and remove the nozzle or orifice (See Figure C). Save the Packing for re-use with the replacement Gas Orifice.

FTCF140

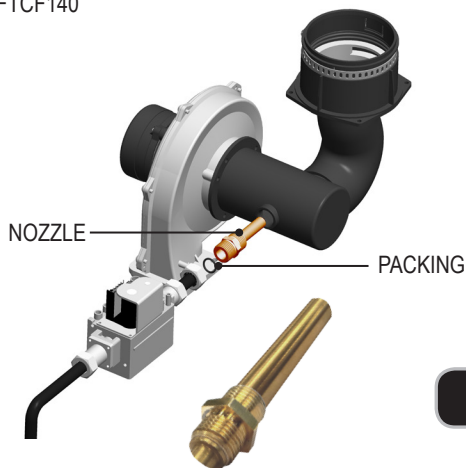

FTCF199

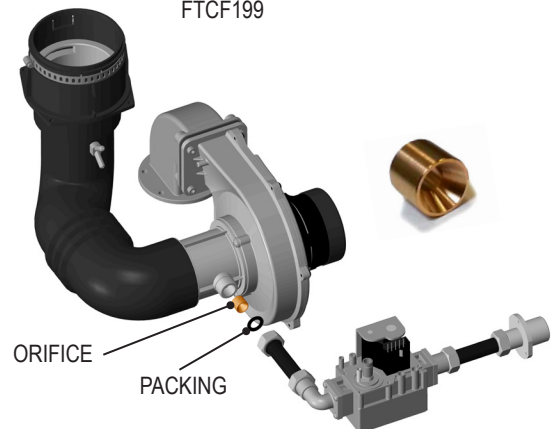



Figure C

7. Remove the existing natural gas nozzle or orifice. If your unit is a FTCF199, note that the conical end of the orifice is towards the valve. Save the packing for re-use. See Figure C.
8. Replace the old Nozzle (or Orifice) with the new one for LP (propane). Re-use the packing from previous.
9. Return the Gas Inlet Pipe to its original position and tighten the Brass Fittings.
10. Per **Table B**, set DIP Switch 5 to the 'OFF' setting (the #5 DIP switch setting for LP Propane is the OFF side).
11. Turn ON the GAS and WATER supply to the FT.
12. Turn ON the FT. 
13. Connect a manometer to the Manifold Pressure Port. See Figure E. For dual port manometers, use the positive pressure side. Check for proper manifold gas pressure. Refer to Table C on next page.
14. Establish a call for heat. You may need to disconnect the outdoor reset if you are making this gas conversion during warm weather.

ON		OFF	
MIN Fire		Normal Operation	
MAX Fire		Normal Operation	
NG Natural		LP Propane	
3" Vent Size		2" Vent Size	
ON	OFF	ON	ON
ON	OFF	OFF	ON
OFF	ON	ON	ON

REFERENCE ONLY. DO NOT CHANGE

MBH N/A 140 N/A 199

Table B DIP Switch Settings

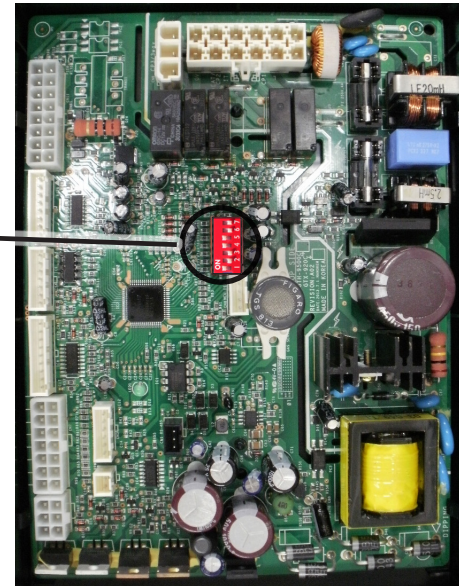


Figure D

15. Setup your combustion analyser and place the sensor into the combustion test port
16. Per Table B for Max Fire, change dip switch 6 to ON and 7 to OFF. The unit will cycle up to MAX fire.
17. WAIT for your combustion analyser to stabilize. This may take up to 3 minutes depending on your combustion analyser. Then check the CO₂ measurement for MAX fire. Refer to Table D for acceptable MAX fire combustion readings. At this point, just record the CO₂ readings at MAX Fire. **Do NOT attempt to adjust CO₂ at MAX Fire. ONLY in MIN Fire, so...**
18. Per Table B for MIN Fire, change dip switch 6 to OFF and 7 to ON. The unit will cycle down to MIN Fire.
19. WAIT for your combustion analyser to stabilize. Then check the CO₂ measurement at MIN fire. Refer to Table D for acceptable MIN fire combustion readings.
20. If CO₂ readings in Max Fire and MIN fire are acceptable, then skip ahead to Step 23. If not, then open the Gas Valve Adjustment Port by removing the cap screw with a 4mm Allen wrench. See Figure E.
21. Then use the 4 mm Allen wrench to make a minor adjustment (1/8 turn) to either increase or decrease CO₂.

Manifold pressure		'NG' type combustibility		'LP' type combustibility	
		2" VENT	3" VENT	2" VENT	3" VENT
FTCF140	MAX Fire	-0.15" WC	-0.216" WC	-0.15" WC	-0.216" WC
	MIN Fire	0" WC	0.002" WC	0.1" WC	0.079" WC
FTCF199	MAX Fire	-0.134" WC		-0.173" WC	
	MIN Fire	-0.015" WC		-0.015" WC	

Table C

CO ₂ value		'NG' type combustibility		'LP' type combustibility	
		2" VENT	3" VENT	2" VENT	3" VENT
FTCF140	MAX Fire	8.5~10.5%		9.5~11 %	
	MIN Fire	8~10%		9~10.5 %	
FTCF199	MAX Fire	8.5~10.0%		9.5~11 %	
	MIN Fire	8~10%		9~10.5 %	

Table D

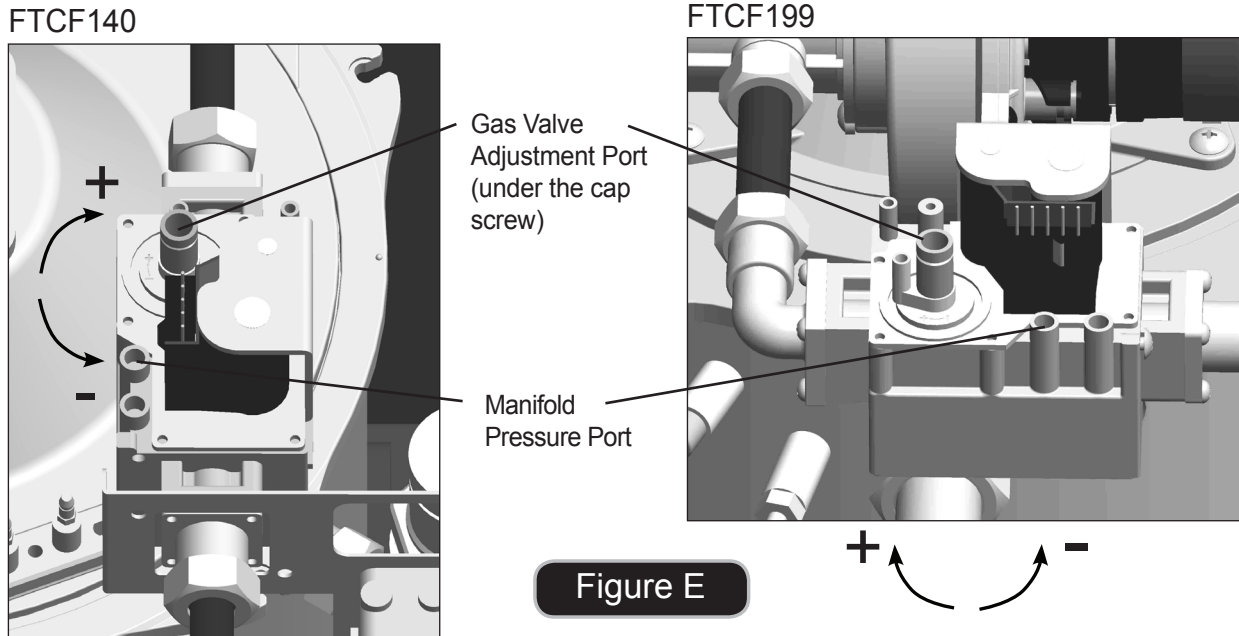


Figure E

- 22.** It may be necessary to go back and forth between HI Fire and LOW Fire several times (and making adjustments ONLY at LOW Fire), before CO₂ at both are within acceptable levels. Be sure to put the cap screw back onto the gas valve adjustment port when done.
- 23.** Once the CO₂ and manifold pressure measurements for both MIN and MAX Fire are acceptable per Table D, set DIP switches 6 and 7 to the OFF position for Nominal Fire (normal operation). The FT is now operating in it's normal mode.
- 24.** Write in the correct Conversion Date and the Technicians Name to the included gas conversion sticker. See Figure F. Then apply that sticker adjacent to the rating plate.
- 25.** Remove your combustion analyser from the combustion test port and be sure to thread the test port plug back into position.
- 26.** Re-connect outdoor reset if it was disconnected previously in this conversion and put the Front Panel and Top Access Panel back on. Tighten them into place using the knob and 4 fasteners that you disassembled in Step 3.

This unit was converted on ___/___/___ to ___ gas with kit # _____ by _____ (name and company _____ accountable) _____ Cette unité a été converti ___/___/___ en ___ gaz en utilisant le kit numéro _____ par _____ (nom et société _____ responsable) _____ _____
--

Figure F (Conversion label)

H2373900B