

# COMMERCIAL 24 VOLT FLUE DAMPER SERIES WATER HEATER

**Gas Water Heaters** 



# SERVICE MANUAL

# Troubleshooting Guide and Instructions for Service

(To be performed ONLY by qualified service providers)

# Models Covered by This Manual:

For The Bradford White "D" Series Models: D38T155 D75T(125,160,300) D65T(370,399) D80T(180,199,250) D80T(425,505) D100T(199,250) D80L(399,450,505) D100L(199,250,270,300) D100S(199,250)

## **Table of Contents**

	<u>Page</u>	eF Service Procedure
Introduction	3	
Tool required for service	3	
Sequence of Operation	4	
Troubleshooting	5	
Thermostat Circuit Testing	6	D24-I
Pilot Operation Testing	8	D24-II
Main Burner Operation testing	10	D24-III
Main Burner & Pilot Removal & Inspection	12	D24-IV
Flue Baffle Removal & Inspection	14	D24-V
Anode Removal & Inspection	15	D24-VI
Generic Parts List	16	
Glossary of Terms	19	



It is intended for this manual to be used by qualified service personal for the primary purpose of troubleshooting analysis and repair of the Bradford White 24 Volt Flue Damper Series Water Heater. Understanding the sequence of operation section of this manual will contribute greatly to troubleshooting this product.

Troubleshooting begins simply by resetting the water heater and observing the lighting sequence to determine failure mode. This step by step procedure beginning on page 5 will direct the service provider to a series of test procedures to determine root cause of failure.

Contact Technical support immediately if diagnosis is not determined using the methods described in this service manual.

# Tools Required for Service

Manometer: Two types available, a liquid "U" tube type or a digital (magna-helic)

type. This device is used to measure gas and/or air pressures and

vacuum.

Multi-Meter: A digital type is strongly recommended. This device is used to measure

electrical values. The meter you select must have the capability to

measure volts AC, volts DC, Amps, micro-amps and ohms.

Thermometer: Used to measure water temperature. An accurate thermometer is

recommended.

Water Pressure Gage: Used to measure water supply pressure. Also used to determine tank

pressure by adapting to the drain valve of the heater.

Jumper Leads: A length of wire (12" min.) with alligator clip at both ends.

Various Hand Tools: Pipe wrench, channel locks, open end wrench set, 12" crescent wrench.

Allen wrench set, torx bit set, screw drivers (common & phillips), long reach (12") magnetic tip phillips head screw driver #2 tip, ½" nut driver, pliers (common & needle nose), socket set including a 1-1/16 deep well socket, wire cutters, wire strippers, wire crimpers, torpedo level, small

shop vac, step ladder, and flashlight.



- 1 Thermostat calls for heat.
  The relay closes on the thermostat board, sending 24 volts from the "COM" terminal of the thermostat board to the flue damper.
- Plue damper begins to rotate open. Once damper is full open, 24 volts is allowed to continue through damper to the "TH" terminal of ignition module.
- (3) LED on ignition module illuminates.
- (4) Trial for ignition (90 second trials, 3 trials with 30 second pause between trials).

Ignition module simultaneously sends:

- 1. 24 volts from "MV/PV" terminal, to "MV/PV" terminal of gas valve (common terminal).
- 24 volts from "PV" terminal, through the ECO located in the lower thermister, to "PV" terminal of gas valve to establish gas flow at pilot.
- 3. Low current high voltage from "spark" terminal, to generate spark at the pilot and ignite pilot gas flow.
- 4. Pilot flame proving signal (measured in micro-amps). from the "sense" terminal, to prove pilot flame.
- <sup>(5)</sup> Once pilot flame is proven, sparking will stop.
- Once sparking stops, 24 volts is sent from "MV" terminal on module, to "MV" terminal on gas valve to establish main burner gas flow. Main burners ignite from the pilot flame.


The ignition module constantly monitors pilot flame. If pilot flame is lost, pilot and main burner are shut down. After a 30 second purge period, module will attempt to re-light pilot beginning at sequence 4 above.


- Main burner fires until the thermostat is satisfied. The relay on the thermostat board opens, interrupting 24 volts through the damper and ignition module. Pilot and main burner is turned off.
- 8 Flue damper rotates to the closed position.

#### **LOCKOUT CONDITION**

Ignition module will "lockout" if the pilot can not be lit after 3 ignition trials. The ignition module indicates a lockout condition by the continues flash of the LED located on the module.

Lockout reset is accomplished by interrupting 120 VAC to the unit for at least 5 seconds.

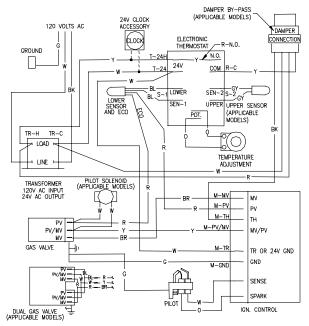




**WIRING DIAGRAM** 



#### **CAUTION**

Use Caution Not to Damage Connectors when making Voltage Measurements or Jumping Terminals

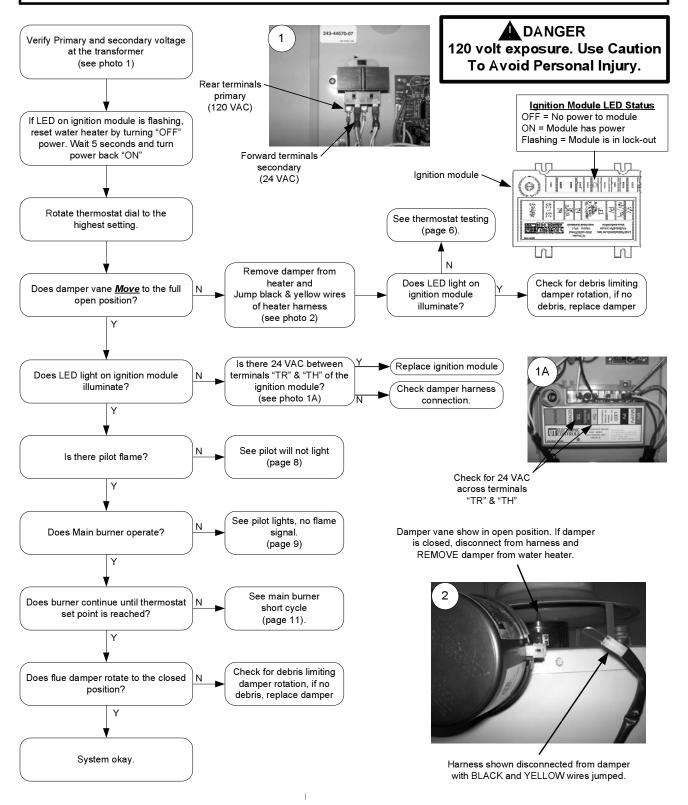




120 volt exposure. To avoid personal injury, use caution while performing this procedure.

#### **CAUTION**

Be Careful When Making Voltage Measurements or Jumping Terminals Not to Damage or Deform Connectors or Connector Pins.

This procedure assumes the flue damper is in working order. Be sure damper opens under its own power when the thermostat circuit is by-passed. Damper must be open or removed during this test. Do not force damper open using your hands or tools.

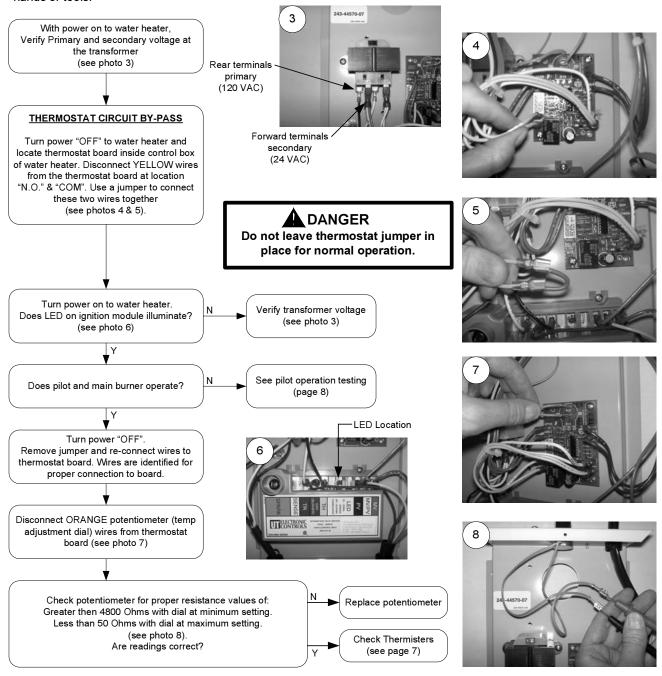




#### **Thermister Resistance Testing**


#### **Upper Thermister:**

- 1. Determine resistance value of upper thermister. Test across grey wires. (see photo 9).
- 2. Draw quart of water off T&P valve. Using a thermometer, determine water temperature.
- 3. Use table below to verify correct resistance per water temperature measured.

#### **Lower Thermister:**

- 1. Determine resistance value of lower thermister. Test across blue wires. (see photo 10).
- 2. Draw quart of water off **Drain Valve**. Using a thermometer, determine water temperature.
- 3. Use table below to verify correct resistance per water temperature measured.

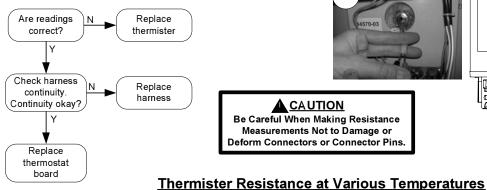

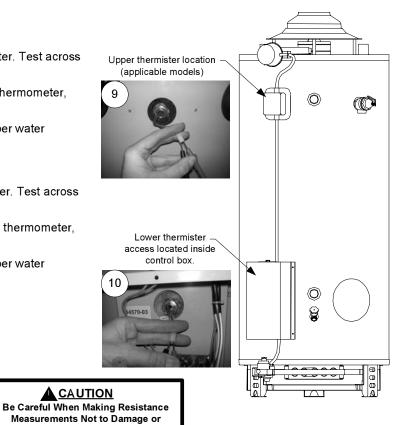

#### Deform Connectors or Connector Pins.


Example: If water temperature is 84°F, then the resistance through the sensor would be 8449 (see shaded area). NOTE: Sensor resistance increases as the temperature falls.

	In Degrees F									
°F	0	1	2	3	4	5	6	7	8	9
40	26109	25400	24712	24045	23399	22771	22163	21573	21000	20445
50	19906	19383	18876	18383	17905	17440	16990	16553	16128	15715
60	15314	14925	14548	14180	13823	13477	13140	12812	12494	12185
70	11884	11592	11308	11032	10763	10502	10248	1000	9760	9526
80	9299	9078	8862	8653	8449	8250	8057	7869	7685	7507
90	7333	7165	7000	6839	6683	6531	6383	6238	6098	5961
100	5827	5697	5570	5446	5326	5208	5094	4982	4873	4767
110	4663	4562	4464	4368	4274	4183	4094	4006	3922	3839
120	3758	3679	3602	3527	3453	3382	3312	3244	3177	3112
130	3048	2986	2925	2866	2808	2752	2697	2643	2590	2538
140	2488	2439	2391	2344	2298	2253	2209	2166	2124	2083
150	2043	2004	1966	1928	1891	1856	1820	1786	1753	1720
160	1688	1656	1625	1595	1566	1537	1509	1481	1454	1427
170	1402	1376	1351	1327	1303	1280	1257	1235	1213	1191
180	1170	1150	1129	1110	1090	1071	1053	1035	1017	999
190	982	965	949	933	917	901	886	871	857	842
200	828	814	801	788	775	762	749	737	725	713



120 volt exposure. To avoid personal injury, use caution while performing this procedure.


#### **CAUTION**

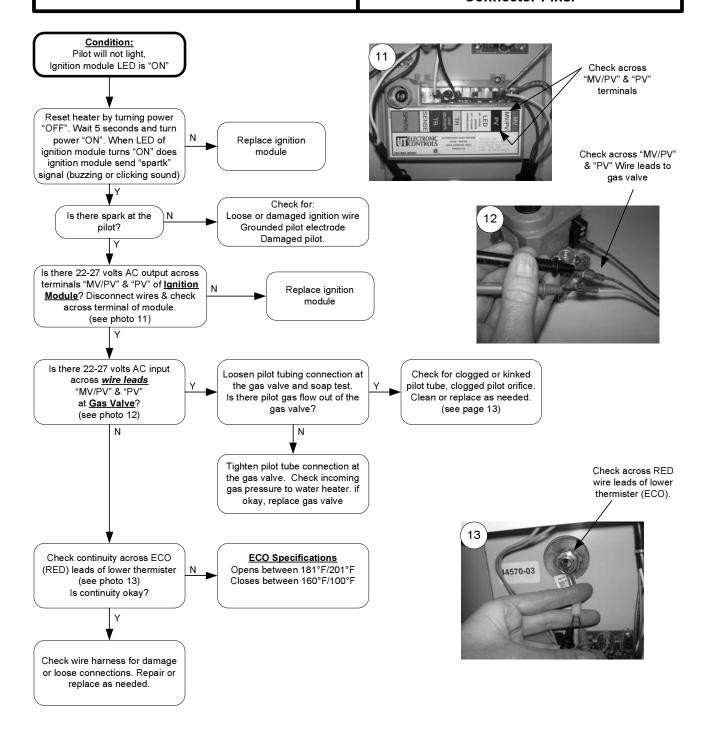




120 volt exposure. To avoid personal injury, use caution while performing this procedure.

#### **CAUTION**

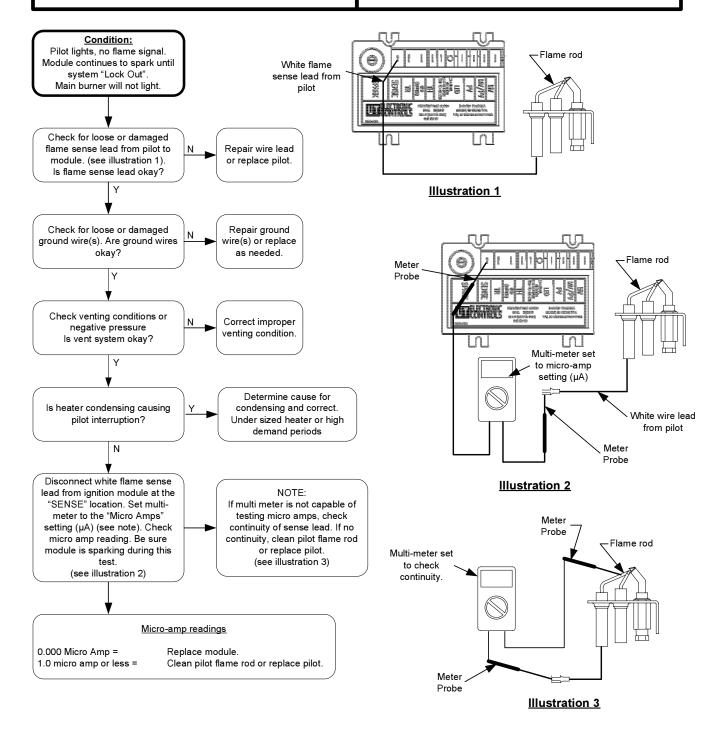

120 volt exposure. To avoid personal injury, use caution while performing this procedure.


#### **CAUTION**

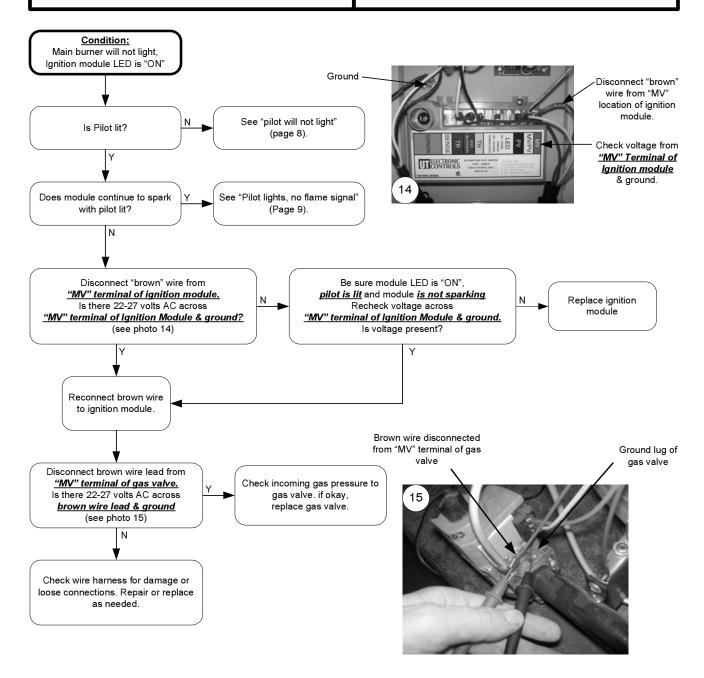



120 volt exposure. To avoid personal injury, use caution while performing this procedure.

#### **CAUTION**

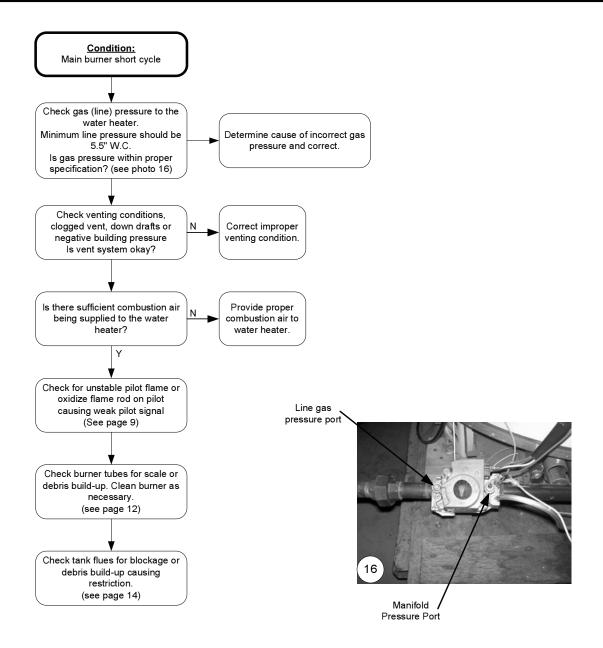



#### **WARNING**

Heater components may be <u>HOT</u> when performing the following steps in this procedure.

Take necessary precaution to prevent personal injury.

Gas Valve

Control Knob

#### **Main Burner Removal**

Step 1. Disconnect (un-plug) water heater from electrical supply.

Gas Supply

Step 2. Turn "OFF" gas supply to water heater.

Step 3. Rotate gas valve control knob to the "OFF" position (see photo 17).

Step 4. Disconnect Gas supply line from the gas valve (see photo 17).

Step 5. Disconnect wire leads from gas valve (see photo 17).

Step 6. Disconnect white flame sense wire & orange ignition wire from Ignition module (see photo 18).


Step 7. Remove the two burner rack mounting screws.

Step 8. Slide complete burner rack out from heater (see photo 19).


Step 9. To install burner, reverse above procedure.


#### **Main Burner Inspection**


- Step 1. Burner tubes should be free of any flue scale or other debris. Clean burner tubes using a stiff brush and/or shop vac. Burner ports should have uniform openings. Replacement is recommended for burners where port area is deteriorated or other unintended openings are present.
- Step 2. Insure pilot shield is in place (see photo 20).
- Step 3. Inspect pilot position to insure smooth burner ignition from pilot flame. Pilot should be mounted using the two mounting screws thru the burner support bracket resulting in a level pilot position.



Burner Rack Mounting Screw










Pilot Shield


#### **Pilot Burner Removal**

- Step 1. With burner rack removed from heater, disconnect pilot tube connection from gas valve
- Step 2. Remove the two pilot burner mounting screws securing the pilot and pilot shield in place.
- Step 3. Remove pilot shield and pilot from burner rack.
- Step 4. To install pilot burner and pilot shield, reverse above procedure. Be sure to reconnect green ground wire.



#### **Pilot Burner Inspection**

- Step 1. Inspect pilot for the following:
  - a) Broken or cracked ceramic insulators. If found, pilot must be replaced.
  - b) Damaged electrode or flame sense wire. If found, pilot must be replaced.
  - c) Oxidation build-up on flame rod. Clean flame rod or replace pilot as necessary.
- Step 2. Inspect pilot orifice:
  - a) Remove 7/16" ferrule nut from bottom of pilot.
  - b) Remove pilot tube and orifice from pilot.
  - c) Inspect pilot tube for blockage. Clean or replace as necessary.
  - d) Inspect pilot orifice for blockage. Clean or replace as necessary.





#### **WARNING**

Heater components may be <u>HOT</u> when performing the following steps in this procedure.

Take necessary precaution to prevent personal injury.

- Step 1. Disconnect (unplug) water heater from electrical supply.
- Step 2. Disconnect venting from draft diverter and remove draft diverter from top of water heater.
- Step 3. Disconnect flue damper from wire harness and remove flue damper from top of water heater.
- Step 4. If required disconnect top plumbing connection from top of water heater.
- Step 5. Remove screws holding jacket head to top of water heater and remove jacket head from top of water heater.
- Step 6. Remove insulation from top of water heater to expose collector cover.
- Step 7. Remove screw from side (or top) of collector cover and remove collector cover from water heater.
- Step 8. Remove flue baffles from heater. Note, it may be necessary to use pliers to loosen and remove baffles from flue tubes.
- Step 9. Visually inspect flue baffles. Flue baffles should show signs of oxidation, this is normal. If the oxidation has deteriorated any portion of the flue baffle, replacement is recommended. If any restrictors are missing, replacement is recommended.
- Step 10. Upon completion of inspection or subsequent replacement, reinstall flue baffles into heater.
- Step 11. Reinstall collector cover and insulation over collector cover.
- Step 12. Reinstall jacket head, flue damper and draft diverter. Reconnect venting.
- Step 13. Reconnect plumbing connection to top of water heater if required.




#### **A** WARNING

Heater components may be <u>HOT</u> when performing the following steps in this procedure.

Take necessary precaution to prevent personal injury.

- Step 1. Disconnect (unplug) water heater from electrical supply.
- Step 2. Turn "OFF" water supply to water heater.
- Step 3. Open a near by hot water faucet to relieve tank pressure.
- Step 4. Connect hose to drain valve of water heater and route to an open drain. Open drain valve and drain approximately 1 gallon of water from the water heater. Close drain valve and disconnect drain hose from water heater.
- Step 5. Disconnect venting from draft diverter and remove draft diverter from top of water heater.
- Step 6. Disconnect flue damper from wire harness and remove flue damper from top of water heater.
- Step 7. If required disconnect top plumbing connection from top of water heater.
- Step 8. Remove screws holding jacket head to top of water heater and remove jacket head from top of water heater.
- Step 9. Remove insulation from top of water heater to expose collector cover.
- Step 10. Remove screw from side (or top) of collector cover and remove collector cover from water heater.
- Step 11. Locate and remove anode rods from top of water heater (1-1/16 hex socket).
- Step 12. Visually inspect anode rod. Anode rod should show signs of depletion, this is normal. If the depletion is half the original diameter (approximately ¾"), replacement is recommended. If any of the steel core of the anode is exposed, replacement is recommended.
- Step 13. Upon completion of inspection or subsequent replacement, reinstall anode rods into heater.
- Step 14. Reinstall collector cover and insulation over collector cover.
- Step 15. Reinstall jacket head, flue damper and draft diverter. Reconnect venting.
- Step 16. Reconnect plumbing connection to top of water heater if required.
- Step 17. Restore water supply and power to water heater.



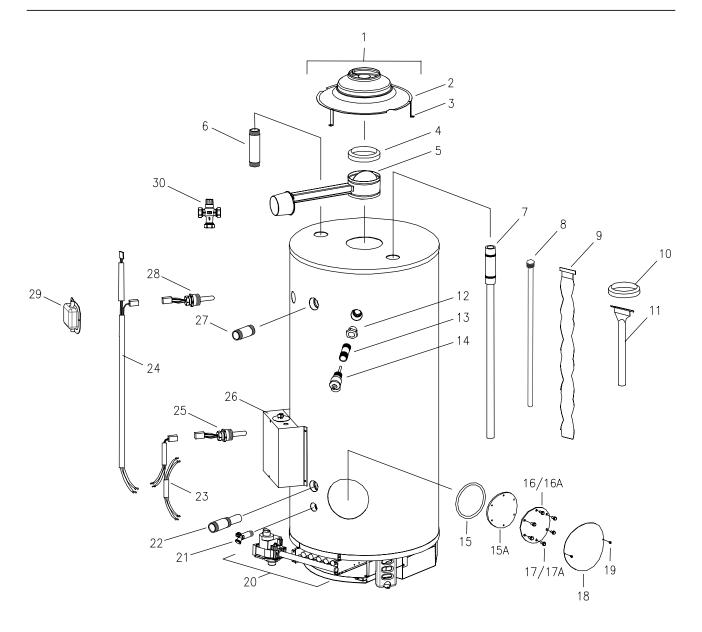


- 1. Draft Diverter w/Leg Kit.
- 2. Draft Diverter.
- 3. Draft Diverter Leg.
- 4. Damper Outlet Reducer.
- 5. Flue Damper.
- 6. Hot Outlet Nipple.
- 7. Cold Water Inlet Dip Tube.
- 8. Hex Head Anode.
- 9. Flue Baffle.
- 10. Flue Reducer.

- 11. Flue Core.
- 12. 1" x ¾" Reducer Bushing.
- 13. Nipple T&P Valve.
- 14. T&P Valve.
- 15. Cleanout O-Ring.
- 15A. Cleanout Gasket (ASME).
- 16. Cleanout Access Cover.
- 16A. Cleanout Access Cover (ASME).
- 17. Cleanout Cover Screw.
- 17A Cleanout Cover Screw (ASME)
- 18. Cleanout Jacket Cover.
- 19. Cleanout Jacket Cover Screw.
- 20. Burner Assembly Complete.

- 21. Brass Drain Valve.
- 22. Cold Water Inlet Nipple (side).
- 23. Gas Valve Harness.
- 24. Damper Harness.
- 25. Lower Thermister.
- 26. Control Box Assembly Complete.
- 27. Hot Water Outlet Nipple (side).
- 28. Upper Thermister.
- 29. Utility Cover.
- 30 ASSE Approved Nixing Valve.



#### Generic Parts List

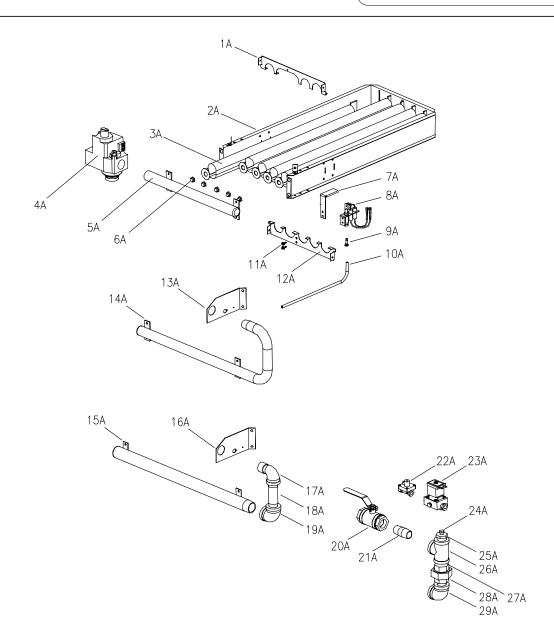


- 1A. Draft Panel.
- 2A. Burner Rack.
- 3A. Burner Tube.
- 4A. Gas Valve.
- 5A. Burner Manifold.
- 6A. Main Burner Orifice.
- 7A. Pilot Shield.
- 8A. Pilot Burner.
- 9A. Pilot Orifice.
- 10A. Pilot Tubing.

- 11A. Pilot Mounting Screw.
- 12A. Burner Tube Support.
- 13A. Manifold Bracket.
- 14A. C-Cane Manifold.
- 15A. Manifold Straight.
- 16A. Manifold Bracket.
- 17A. 90° Street Elbow Black.
- 18A. 1" Down Pipe Nipple Black.
- 19A. 1" 90° Elbow Black.
- 20A. 1" Manifold Ball Valve.

- 21A. 1" Close Nipple Black.
- 22A. Pilot Regulator.
- 23A. Pilot Solenoid.
- 24A. 1/8" Pipe Plug Black.
- 25A. 1" x 1/8" Reducer Bushing.
- 26A. 1" pipe Tee Black.
- 27A. 1" Close Nipple Black
- 28A. 1" Union Black.
- 29A. 1" 90° elbow Black.



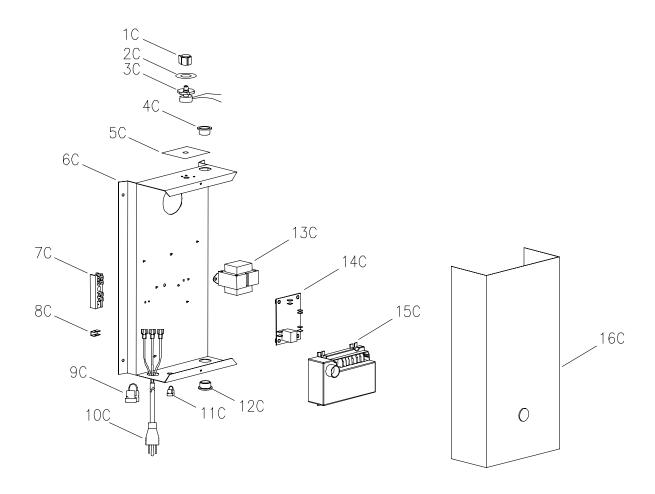

- 1C. Temperature Control Knob.
- 2C. Potentiometer Gasket.
- 3C. Potentiometer (Temperature Control).
- 4C. 7/8" Snap Bushing.
- 5C. Temperature Scale Plate.
- 6C. Control Box Panel.
- 7C. Terminal Strip.
- 8C. Ground Terminal.

- 9C. Power Cord train Relief Bushing.
- 10C. Power Cord.
- 11C. Pilot wire Strain Relief Bushing.
- 12C. 7/8" Snap Bushing.
- 13C. Transformer.
- 14C. Thermostat Board.
- 15C. Ignition Module.
- 16C. Control Box Cover.



# **Glossary of Terms**

AC	Alternating Current	
BTU/H	British Thermal Units	
CO	Carbon Monoxide	
CO2	Carbon Dioxide	
DC	Direct Current	
ECO	Energy Cut Off	
GFI	Ground fault interrupt	
GPM	Gallons per Minute	
Hz	Hertz	
LED	Light Emitting Diode	
NOx	Oxides of Nitrogen	
NPT	National Pipe Thread	
PSI	Pounds per Square Inch	
VA	Volt Amps	
VAC	Volts Alternating Current	
W.C.	Inches of Water Column	
°C	Degrees Centigrade	
°F	Degrees Fahrenheit	
μA	Micro Amp	
'	'	
NOTES		





WATER HEATERS
Ambler, PA

For U.S. and Canada field service, contact your professional installer or local Bradford White sales representative.

Sales/**800-523-2931** Fax/**215-641-1670** Parts Fax/**215-641-2180** 

Technical Support/800-334-3393 Fax/269-795-1089

Warranty/**800-531-2111** *Fax/***269-795-1089** 

International: Telephone/215-641-9400 Telefax/215-641-9750

# BRADFORD WHITE-CANADA® INC.

Mississauga, ON

Sales/866-690-0961 905-238-0100

Fax/905-238-0105
Technical Support/800-334-3393

Email parts@bradfordwhite.com techserv@bradfordwhite.com

www.bradfordwhite.com