
## **Brute**



Date: Project #:	Outdoor Sizes 399-850  Submittal Data  BRADFORD WHITE*
Engineer:	Project Name:
Prepared By:	Location:
Bid Date:	Contractor:

**BNTH** 

## Standard Equipment

- Meets ANSI Z21.13-2013, section 5.26 boilers for outdoor installations
- Integrated PID temperature and ignition control with large color touchscreen display
- Password-protected parameters for installer use
- Test feature allows forced min or max firing
- Complete diagnostics for analog and digital inputs
- Displays holds, alerts and errors in clear text form
- Dry alarm contacts for ignition failure
- · High condensing efficiency
- Modulation down to 20% of full fire (5:1 turndown)
- Sealed combustion chamber
- · Pre-mix stainless steel burner
- Low NOx system exceeds the most stringent regulations for air quality - 10 ppm NOx

- · Built-in condensate trap
- · Vent temperature cutoff feature
- · Direct spark ignition system
- · Indirect water heater priority
- Sensor for indirect domestic water tank
- 160 psi maximum working pressure
- Stainless steel heat exchanger with welded construction (no gaskets)
- · ASME "H" stamp
- 75 psi (517 kPa) ASME rated pressure relief valve
- Water flow switch
- Temperature & pressure gauge
- · Drain valve
- Multiple pump control for boiler pump, system pump and indirect domestic water pump, each with delay
- Alarm output

 Accepts external 4-20mA (0-10V with optional convertor) modulation signal

**Hydronic Boiler** 

Hydronic Boiler

- Outdoor reset with customizable reset curves, domestic hot water override and warm weather shutdown
- · Outdoor air temperature sensor
- On/off toggle switch
- · Manual reset high limit
- Burner site glass
- Zero clearance to combustible surfaces
- Built-in cascade function for up to eight Brutes.
- 10-year limited warranty

	ler		

Number of Units:



Fuel

NaturalPropane

**Pump Options** 

Pump included

No pump

Factory Mounted Options CSD-1

(covers FM & GAP) (500-850)

Low water cutoff (500-850)

High & Low gas pressure switches (500-850)

Additional auto reset high limit

30 psi pressure relief valve

75 psi pressure relief valve (std)

125 psi pressure relief valve150 psi pressure relief valve

Bell for ignition failure











### Accessories for Field Mounting

Low water cutoff
0 - 10V converter for modulation control

High & Low gas pressure switches

Boiler pump

Propane conversion kit
Condensate neutralizer kit

BACnet gatewayLON gateway

■ Variable Speed Pump Control

Sizing Data

Model	Inpu		Outp		AFUE	Thermal Efficiency	Comb. Efficiency	Gas Conn. Size	Water Conn. Size	Shipp Weig	ght
	BTU/h	kW	BTU/h	kW		%	%	inches	inches	Lbs	kg
BNTH 399	399,900	117.2	386,000	113.1	N/A	96.5	96.5	¾ NPT	1¼ NPT	364	165
BNTH 500	500,000	146.4	475,000	139.2	N/A	95.0	95.0	1 NPT	1½ NPT	419	190
BNTH 600	600,000	175.7	572,000	167.6	N/A	95.3	96.0	1 NPT	1½ NPT	426	193
BNTH 750	750,000	219.8	724,000	212.1	N/A	96.6	96.6	1½ NPT	2 NPT	481	218
BNTH 850	850,000	248.9	813,000	238.2	N/A	95.7	95.7	1½ NPT	2 NPT	503	228

#### NOTES:

For other boiler ratings:

Boiler Horsepower: HP = Output 33,475

Radiation Surface: EDR sq. ft. = Output

#### Clearances

Appliance	Suggested Access Cl						
Surface	inches	cm					
Left Side	12	31					
Right Side	12	31					
Top (for flue)	48	122					
Back	12	31					
Closet, Front	1	2.5					
Alcove, Front	24	61					
Vent	Per Vent Ma	nufacturer					
Certified by CSA for zero clearance to combustible materials on all sides.							

Electrical Data

Boiler	Boiler	Circuit	Boiler Pump Circuit			
Size MBH	399-500	600-850	399	500	600-850	
Voltage	120V 1PH	120V 1PH	120V 1PH	120V 1PH	120V 1PH	
FLA	< 4 Amps	5 Amps	< 4 Amps	6 Amps	12 Amps	
MCA	< 4 Amps	6 Amps	5 Amps	8 Amps	15 Amps	
MOP	5 Amps	11 Amps	8 Amps	14 Amps	27 Amps	

FLA = Full Load Amperage

MCA = Minimum Circuit Ampacity

MOP = Maximum Over-current Protection

\* Note: For any pump(s) exceeding 7.4 FLA / 120V VAC, an external pump relay / contactor must be used. Units that are purchased with pumps include the contactor if the pump exceeds this limit.

### Vent System

	Intake (Air)	ake (Air) Exhaust (Vent) Maximum		llowable
Size	Pipe	Pipe	Equivalent l	Length*
399	4"	4"	100 ft	30 m
500	4"	4" 4"		30 m
600	4"	4"	40 ft	12 m
600	6"**	6"**	100 ft **	30 m**
750	4"	4"	40 ft	12 m
750	6"	6"	100 ft	30 m
850	4"	4"	40 ft	12 m
	6"	6"	100 ft	30 m

Installations in the U.S. require exhaust vent pipe that is a combination of PVC & CPVC complying with ANSI/ASTM D1785 F441, polypropylene pipe that complies with ULC S636, or stainless steel complying with UL1738. Installations in Canada require exhaust vent pipe that is certified to ULC S636.

Intake (air) pipe may be ABS, PVC, CPVC or galvanized material.

Installer must comply fully with manufacturer's installation instructions, including use of minimum exhaust length CPVC, to maintain ANSI Z21.13 safety certification.

Closet and alcove installations do not allow the use of PVC under any circumstances

- \* To calculate max equivalent length, measure the linear feet of the pipe, and add 5 feet (1.5m) for each elbow used.
- \*\* Allowed only if the vent pipe is no more than 20 equivalent feet longer than the air pipe.

# Water Flow Requirements


Temperature	Rise	in	°F	
-------------	------	----	----	--

	20	0°F	30	)°F	4(	)°F	50	)°F	60	)°F
	Flow	H/L								
Size	gpm	feet								
399	39.0	22.8	25.0	11.5	19.0	7.6	15.2	5.4	12.6	4.0
500	48.0	22.2	32.0	11.1	24.0	6.8	19.0	4.6	15.8	3.4
600	58.0	30.5	38.0	14.9	29.0	9.4	22.8	6.3	19.0	4.6
750	72.0	38.0	48.0	17.5	36.0	10.1	28.5	6.5	23.8	4.6
850	81.0	34.8	54.0	17.4	41.0	10.9	32.3	7.3	26.9	5.3

#### Temperature Rise in °C

	11°C		17°C		22	22°C		28°C		33°C	
	Flow	H/L	Flow	H/L	Flow	H/L	Flow	H/L	Flow	H/L	
Size	lpm	m	lpm	m	lpm	m	lpm	m	lpm	m	
399	147.6	6.9	94.6	3.5	71.9	2.3	57.5	1.6	47.7	1.2	
500	181.7	6.8	121.1	3.4	90.8	2.1	71.9	1.4	59.8	1.0	
600	219.6	9.3	143.8	4.5	109.8	2.9	86.3	1.9	71.9	1.4	
750	272.5	11.6	181.7	5.3	136.3	3.1	107.9	2.0	90.1	1.4	
850	306.6	10.6	204.4	5.3	155.2	3.3	122.3	2.2	101.8	1.6	

Note that pumps supplied with boilers are meant for primary-secondary piping systems, and are sized to serve the boiler and 30 feet of boiler loop piping with a typical number of fittings, for approximately 25-30°F temp rise across the boiler.

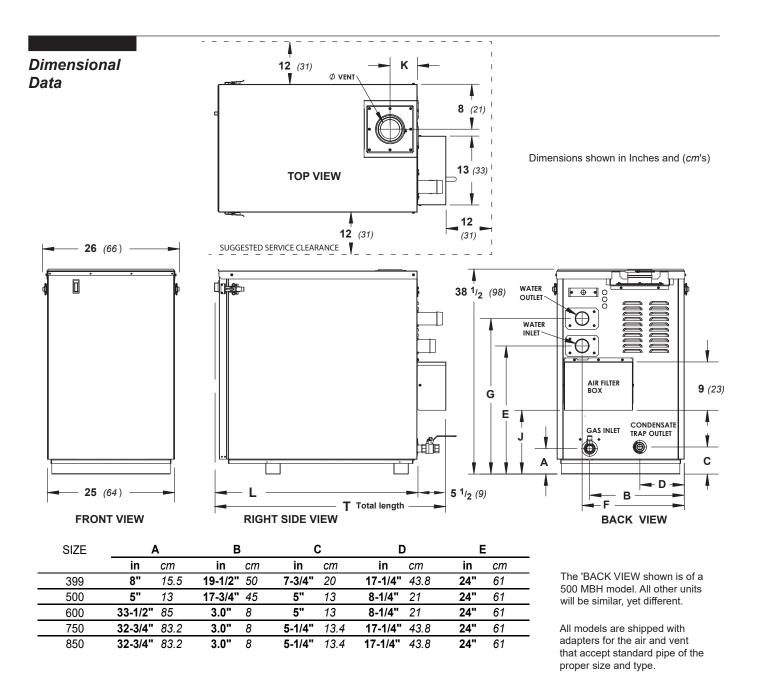

SIZE	F	G	J	K	<b>L</b> (Length)	<b>T</b> (Total Length)	VENT Ø
	in cm	in cm	in cm	in cm	in cm	in cm	in cm
399	<b>19"</b> 48	<b>28-1/4"</b> 72	<b>12"</b> 30.5	<b>6"</b> 15.2	<b>31-1/4""</b> 80.5	<b>37-3/4"</b> 96	4 11
500	<b>19"</b> 48	<b>29-1/4"</b> 74	<b>12"</b> 30.5	<b>5.5"</b> 14	<b>38"</b> 96.5	<b>43-1/2"</b> 110.5	<b>4</b> 11
600	<b>19"</b> 48	<b>29-1/4"</b> 74	<b>12"</b> 30.5	<b>5-3/4"</b> 14.6	<b>38"</b> 96.5	<b>43-1/2"</b> 110.5	<b>4</b> 11
750	<b>19"</b> 48	<b>29-1/4"</b> 74	<b>12"</b> 30.5	<b>5-3/4"</b> 14.6	<b>51-1/4"</b> 130	<b>57-3/4"</b> 146.7	6 17
850	<b>19"</b> 48	<b>29-1/4"</b> 74	<b>12"</b> 30.5	<b>5-3/4"</b> 14.6	<b>55-3/4"</b> 141.5	<b>61-1/4"</b> 155.5	6 17

Bradford White Corporation reserves the right to change specifications, components, features, or to discontinue products without notice.

